
Saba KVS 20


für Wechselstrom 110-240 Volt

Die SABA - Kraft - Netzendstufe



Schaltschema für SABA KVS 20

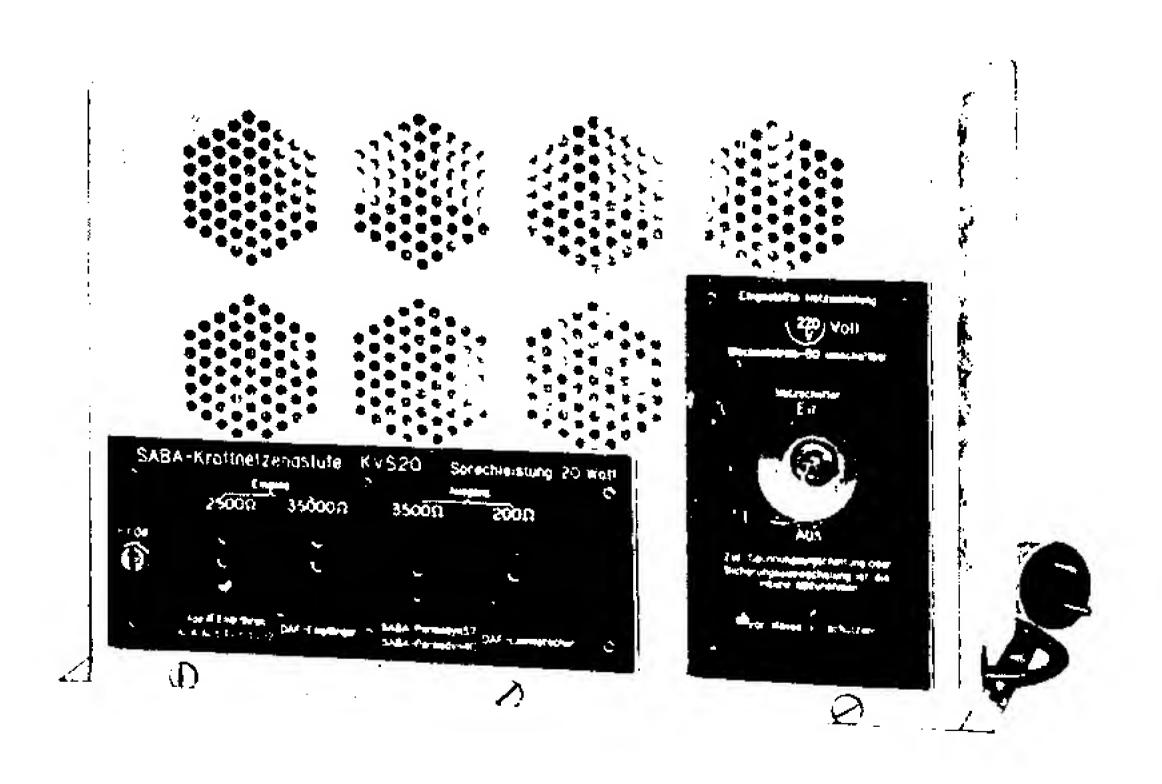

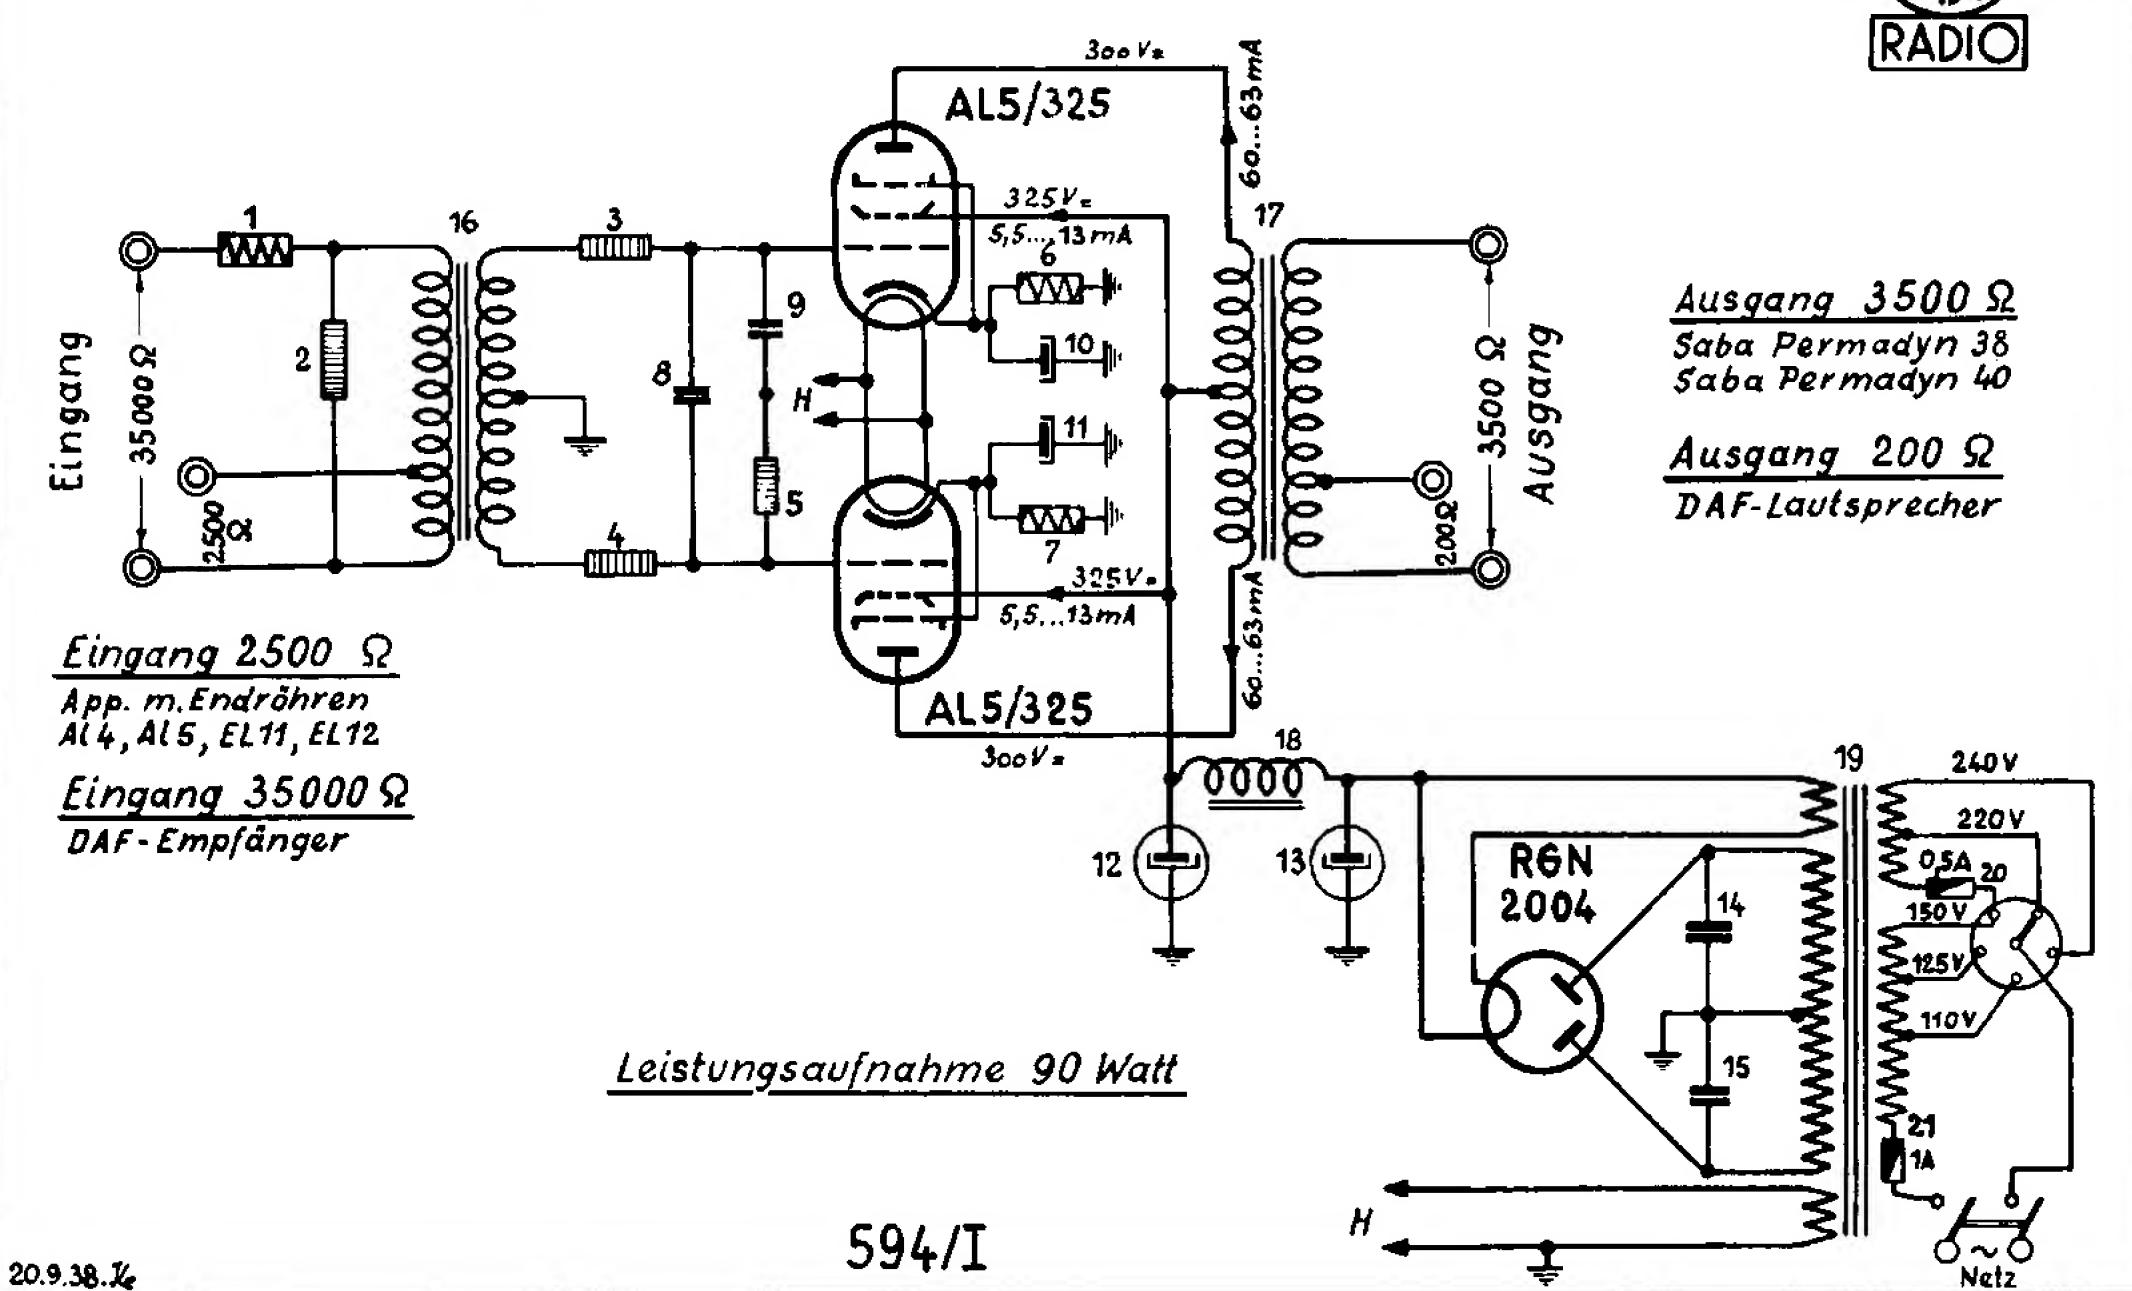

Stückliste zum Schaltbild 594/1 SABA KVS 20

Nr.	Widerstände	Bestell-Nr.	Nr.	Kondensatoren	Bestell-Nr.
1	Dr. 6000 Ohm	383/XII	8	500 pF	442/57
2	Ma. 50 K ,,	181/26	9	20 000 ,,	442/66
3	Ma. 15 K ,,	274/27	10	50 µF	452/8
4	Ma. 15 K ,,	274/27	11	50 "	452/8
5	Ma. 50 K ,,	181/26	12	16 ,,	580/81
6	Dr. 300 "	383/111	13	16 "	580/81
7	Dr. 300 ,,	383/III	14	0,01 ,,	453/36
			15	0,01 ,,	453/36
			16 17 18 19 20 21	Eingangstransformator Ausgangstransformator Siebdrossel Netztransformator Sicherung 0,5 Amp. Sicherung 1,0 Amp.	494/VII 497/VI 496/I 573/I 563/76 563/77

Ma. = Massewiderstand Dr. = Drahtwiderstand